



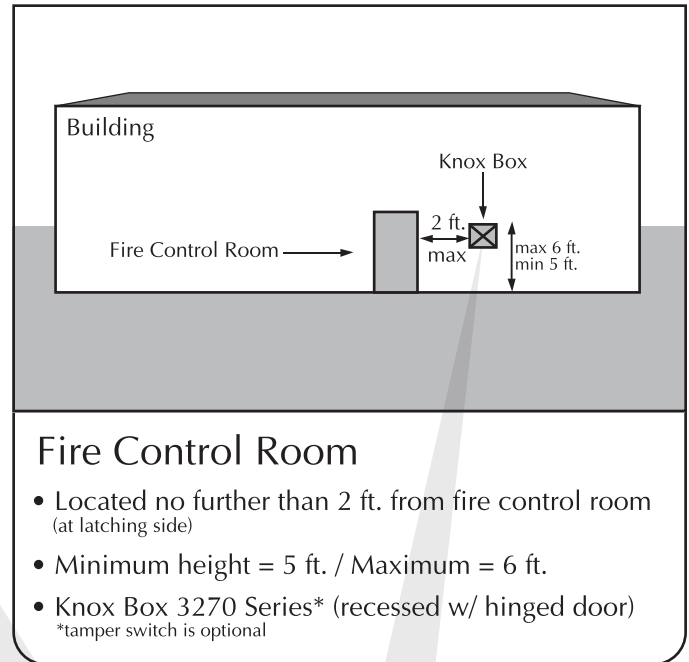

CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION

COMMERCIAL KNOX BOX/VAULT REQUIREMENTS

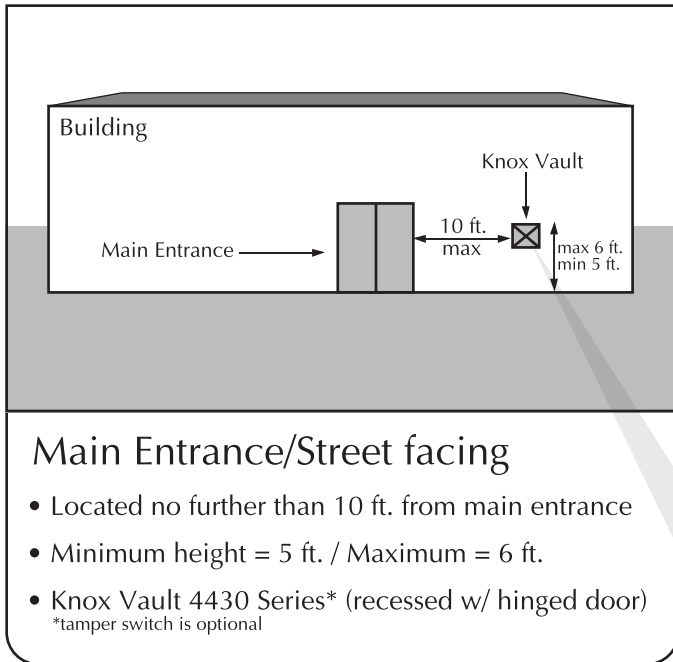

- Each building requires a minimum of two Knox devices (one Knox vault and one Knox box as located above). This requirement can only be waived by the Fire Marshal

- Some buildings will require additional Knox devices


- The "Fire Department" Alert Decal is to be mounted on the Knox device's door or frame

- Keys to be placed into the Knox box will be determined by CVFD Fire Prevention Staff (i.e. master key(s), Fire Control Room, FACP, SDG&E, keys for appliance operation, etc.)

- Required keys shall be secured in knox box/vault prior to final occupancy certification

- Mid and high rise buildings shall provide an additional master key cabinet on the inside of the building with a minimum of six sets of keys

- Install per manufacturers instructions

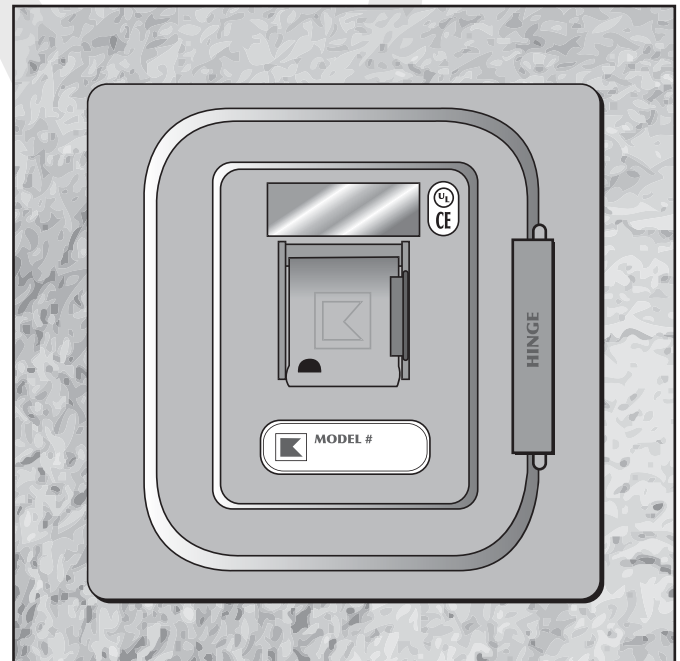

Knox Box/Vault

